

electrical documentation




type	rated voltage	frequency	rated power	rated current
C4e 20.20 GS	120V 1PH	60Hz	1,1kW	9,9A


Welbilt Deutschland GmbH

Talstraße 35
D-82436 Eglfing / Germany
+49 (0)8847 - 67 - 0
+49 (0)8847 - 67 - 414
www.convotherm.com


fuses on site!
Please look at local supply regulations!

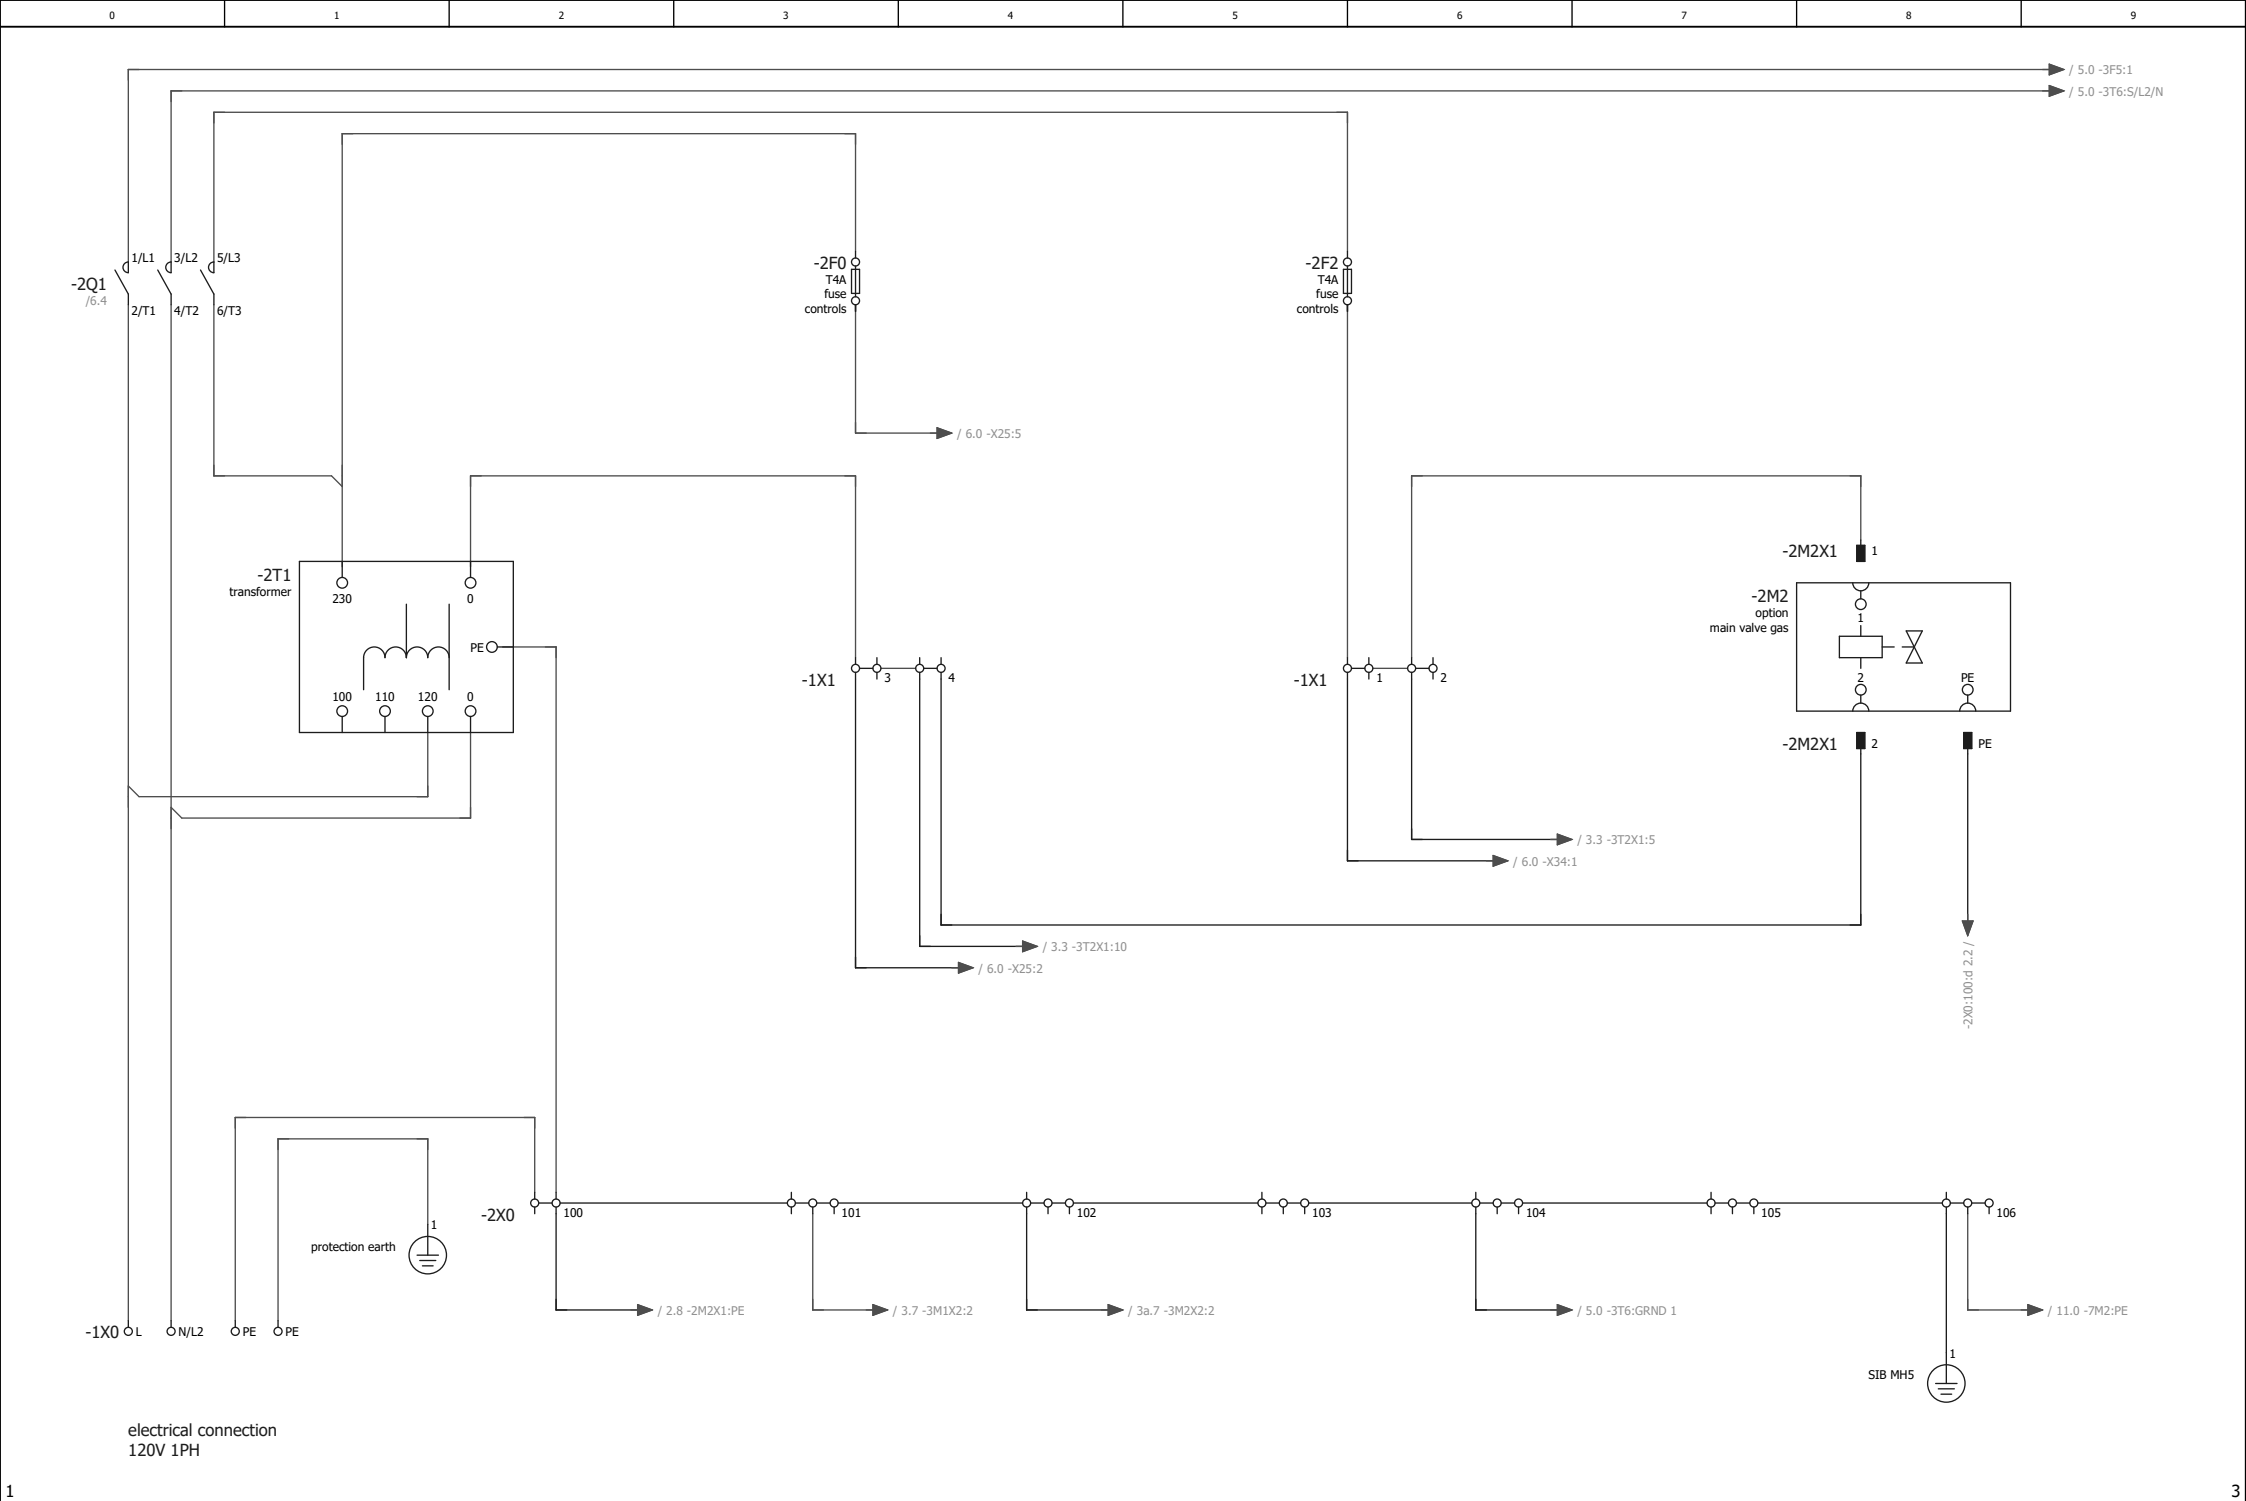



01	ÄM116/2014	23.10.2014	Taf	Drawn	5/25/2022	C4e 20.20 GS	Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014	supply	Project No.	= SLP	
02	ÄM158/2015	10.08.2015	SchM	Name	Boe				5354125	+ MPL	
03	ÄM073/2018	26.07.2018	Taf	App.	SchM				Drq. No.		Blatt
REV	Remarks	Date	Name	Norm				5153069		Seite	2 / 13

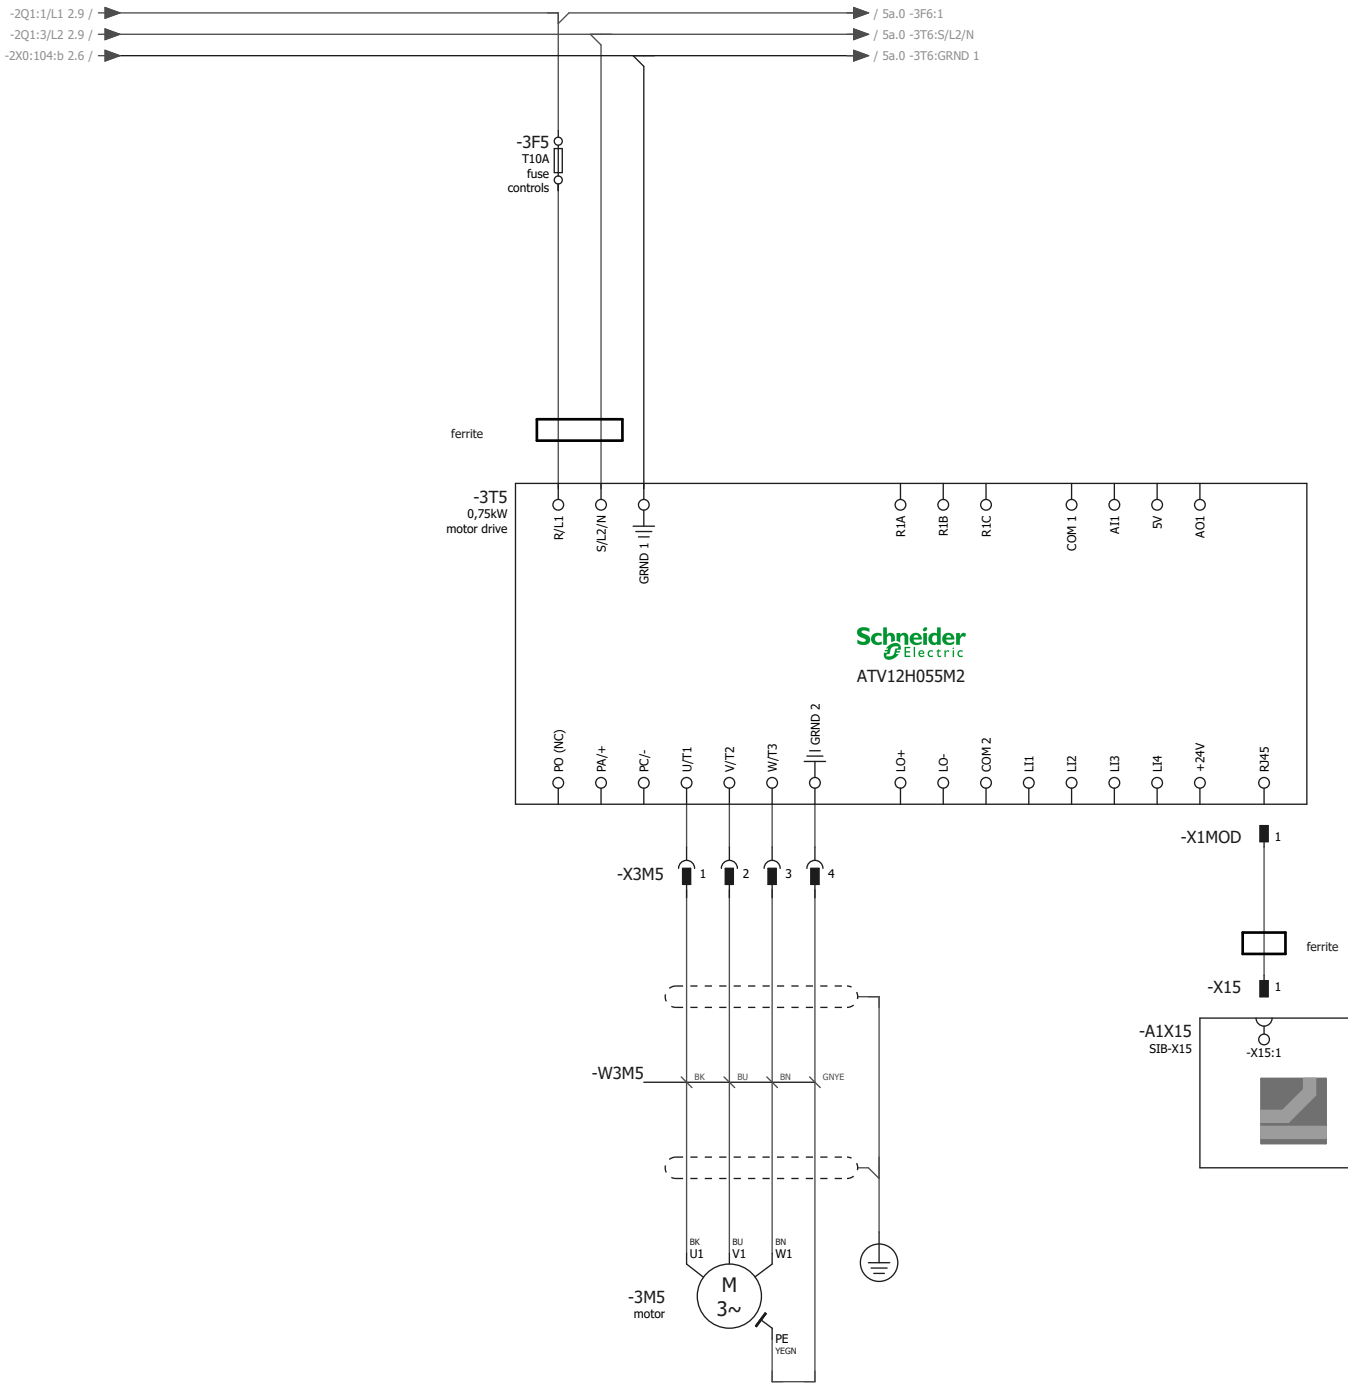



01	ÄM116/2014	23.10.2014	Taf	Drawn	5/25/2022	C4e 20.20 GS	Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @ 2014	motor 1	Project No.		= SLP	
02	ÄM158/2015	10.08.2015	SchM	Name	Boe				5354125		+ MPL	
03	ÄM073/2018	26.07.2018	Taf	App.	SchM				Drg. No.		Blatt	
REV	Remarks	Date	Name	Norm					5153069		Seite 5 / 13	

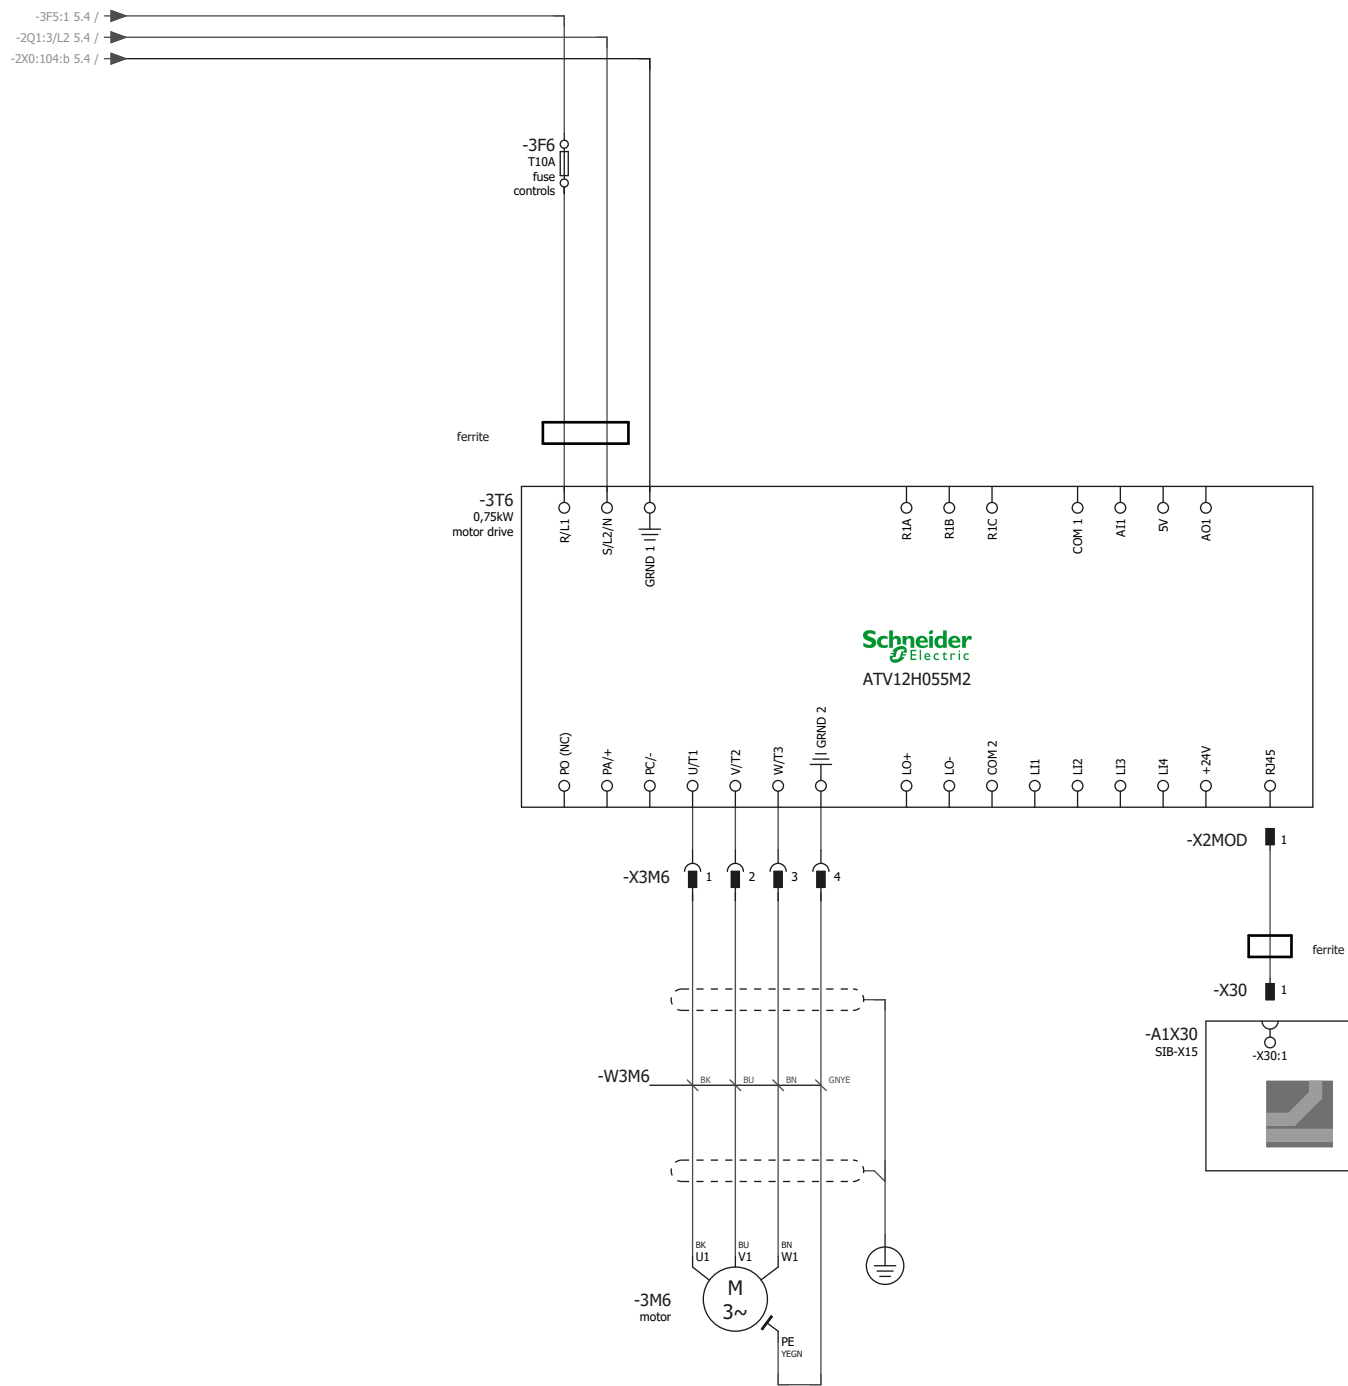


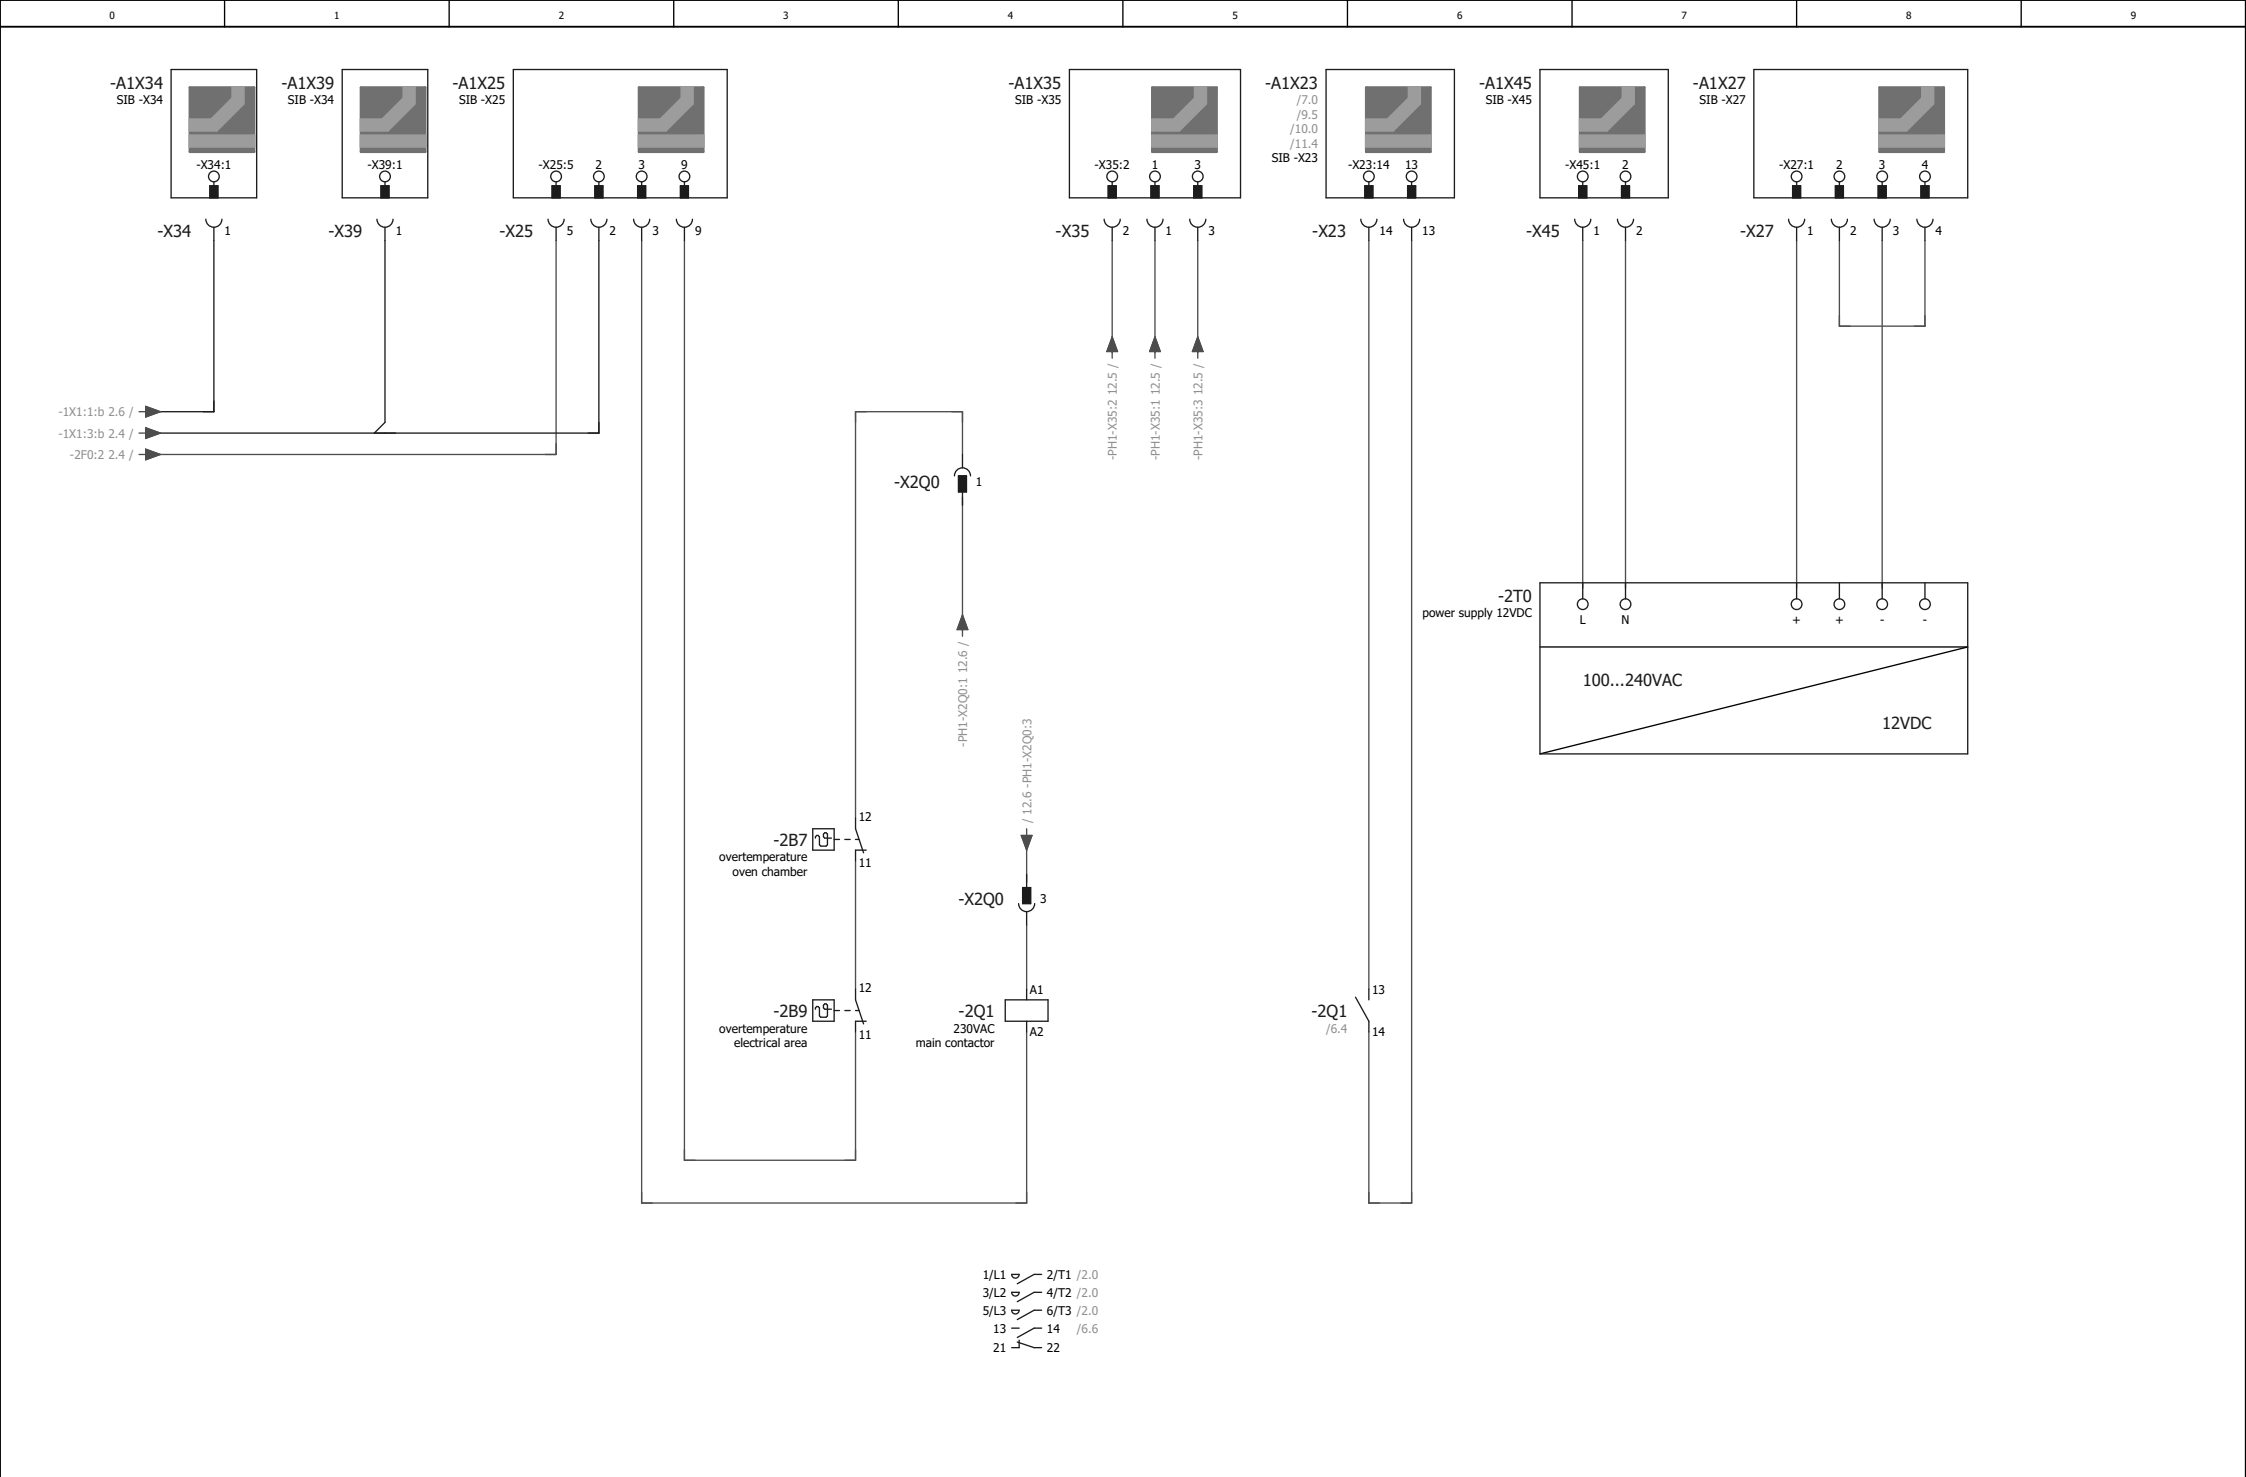

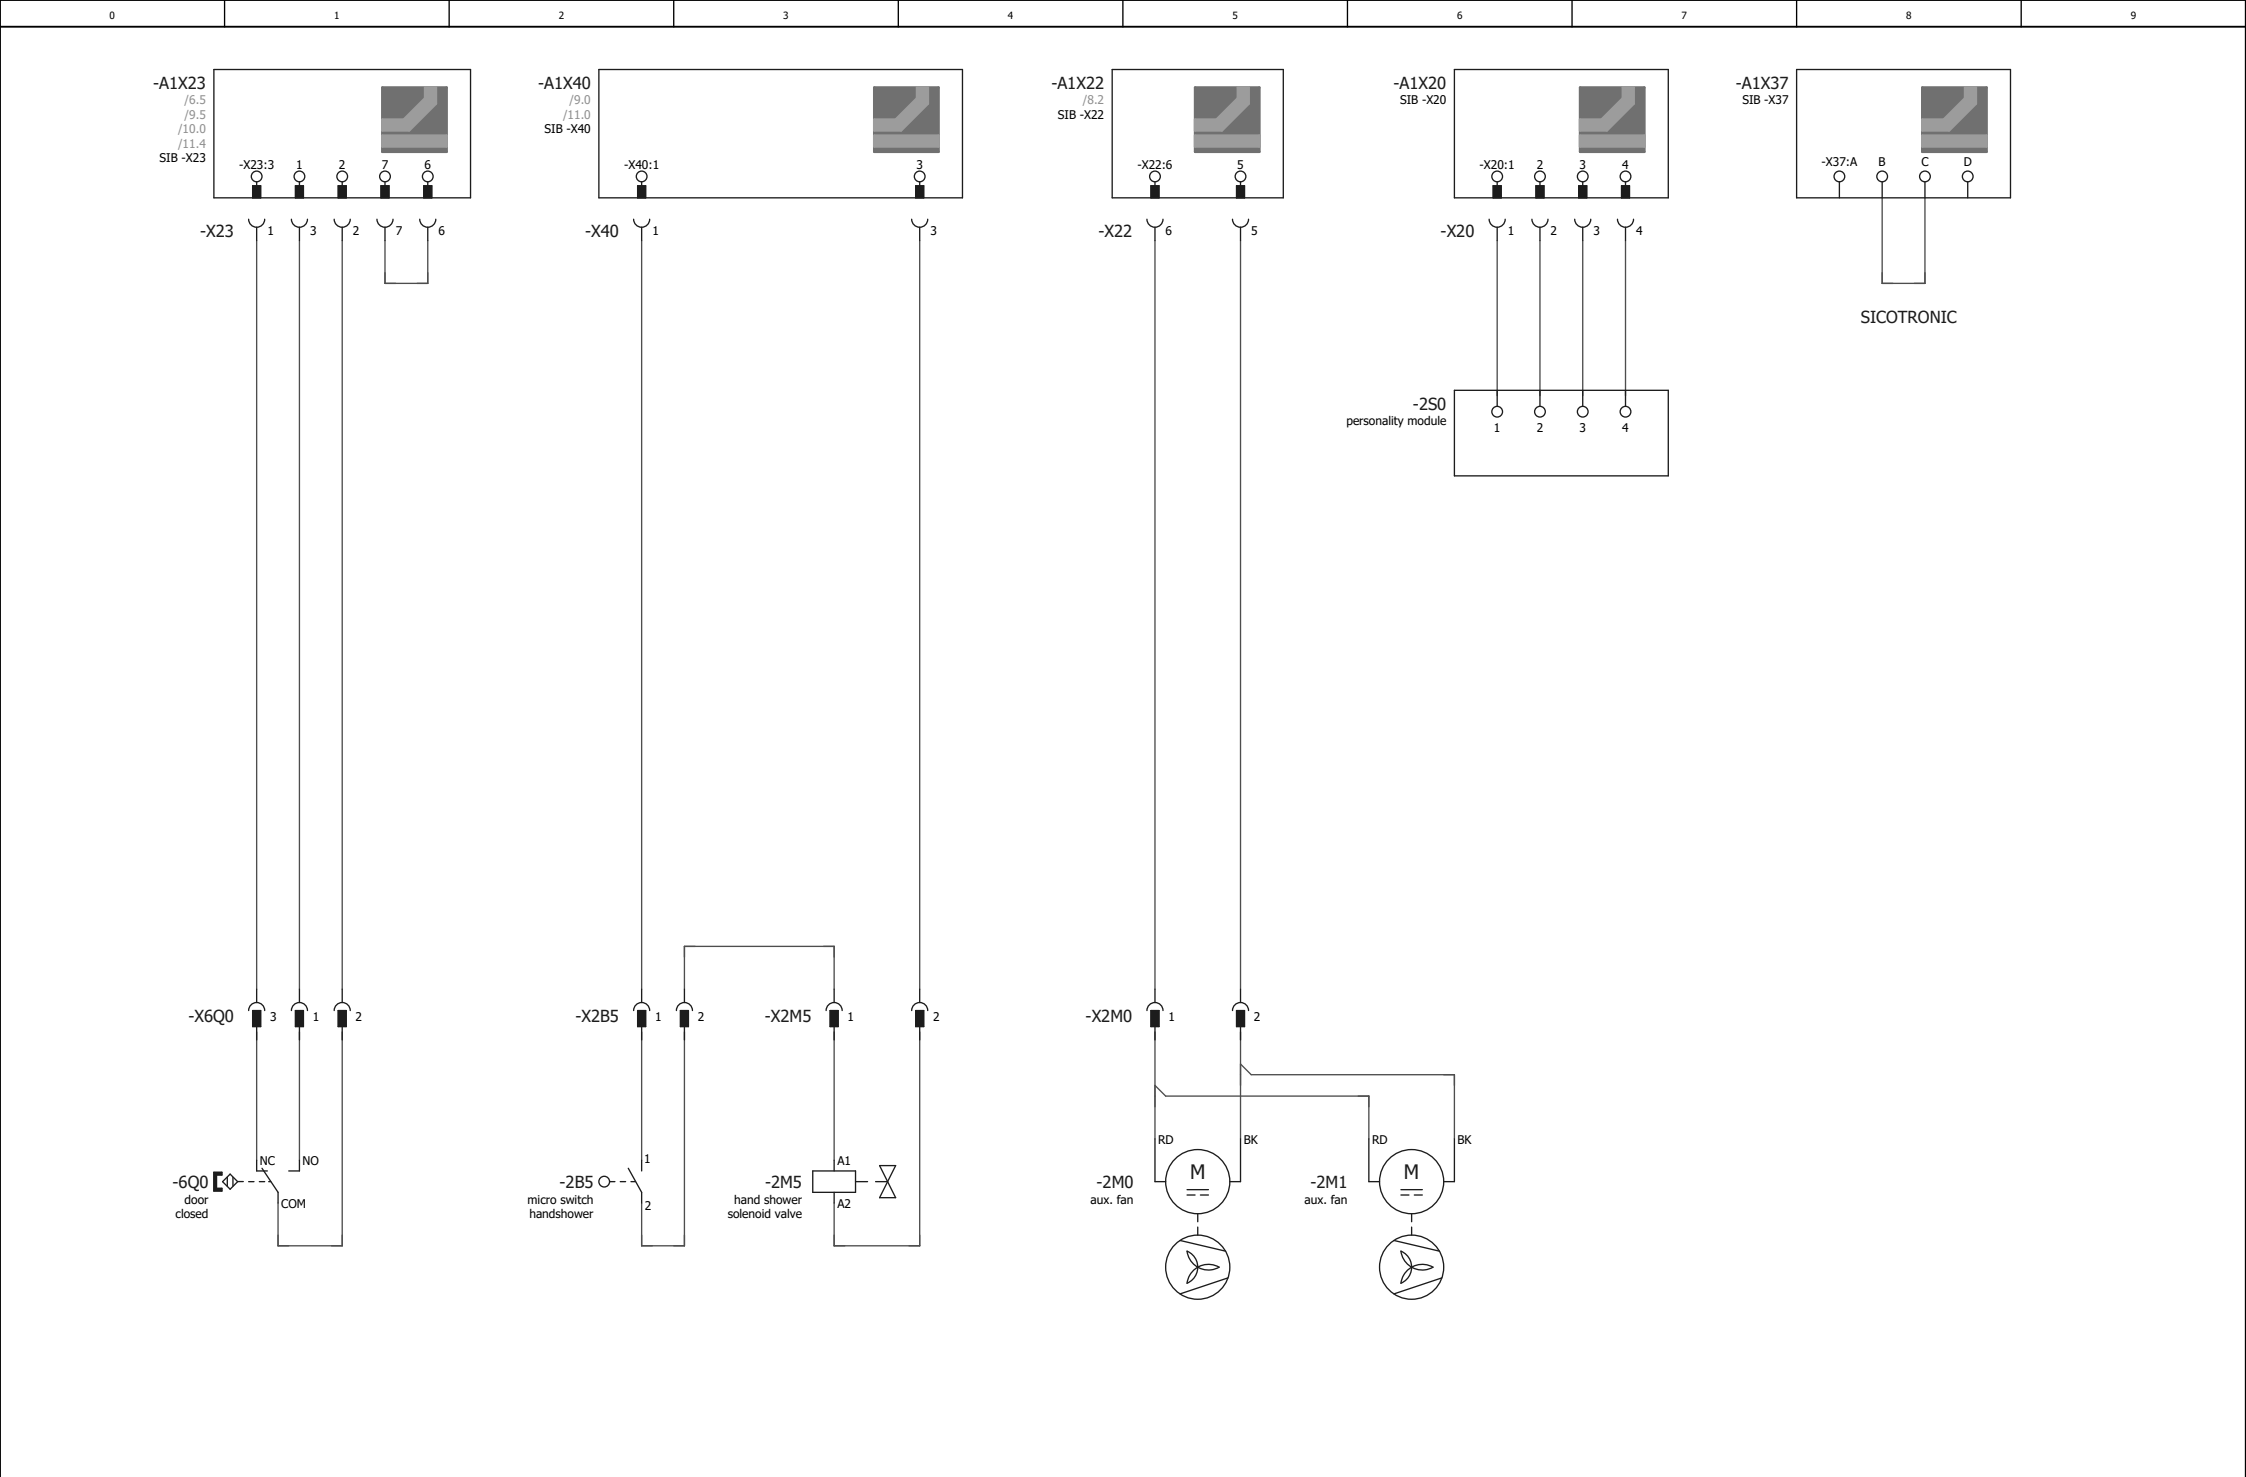

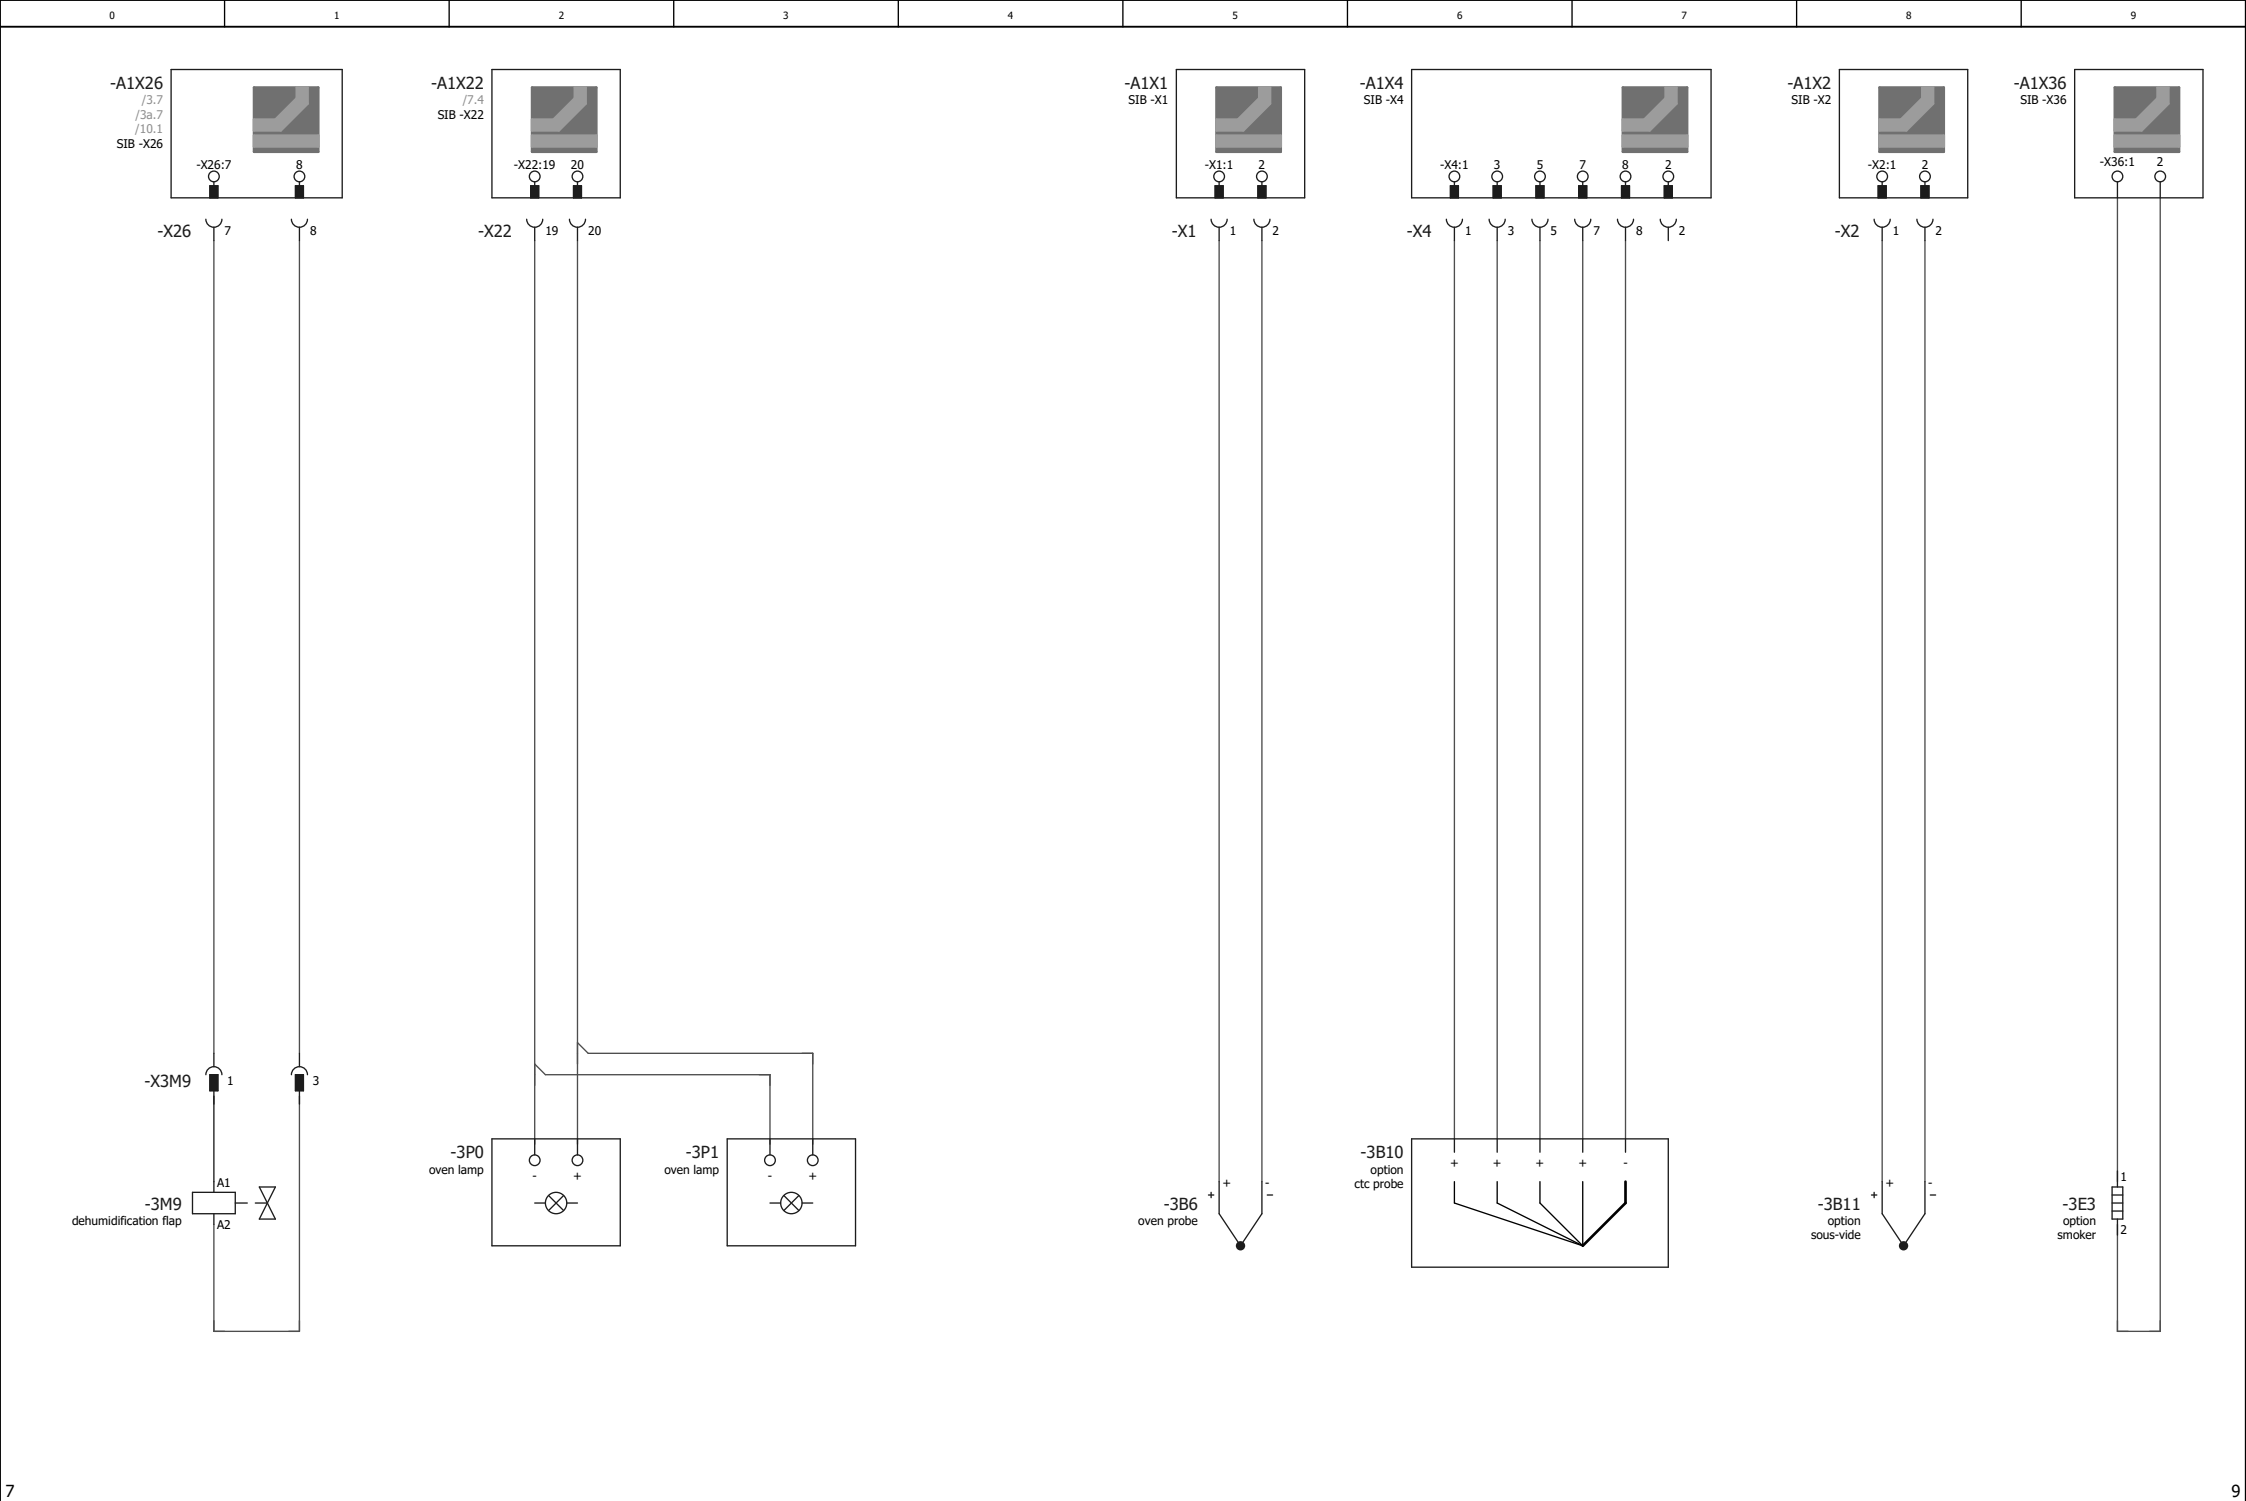

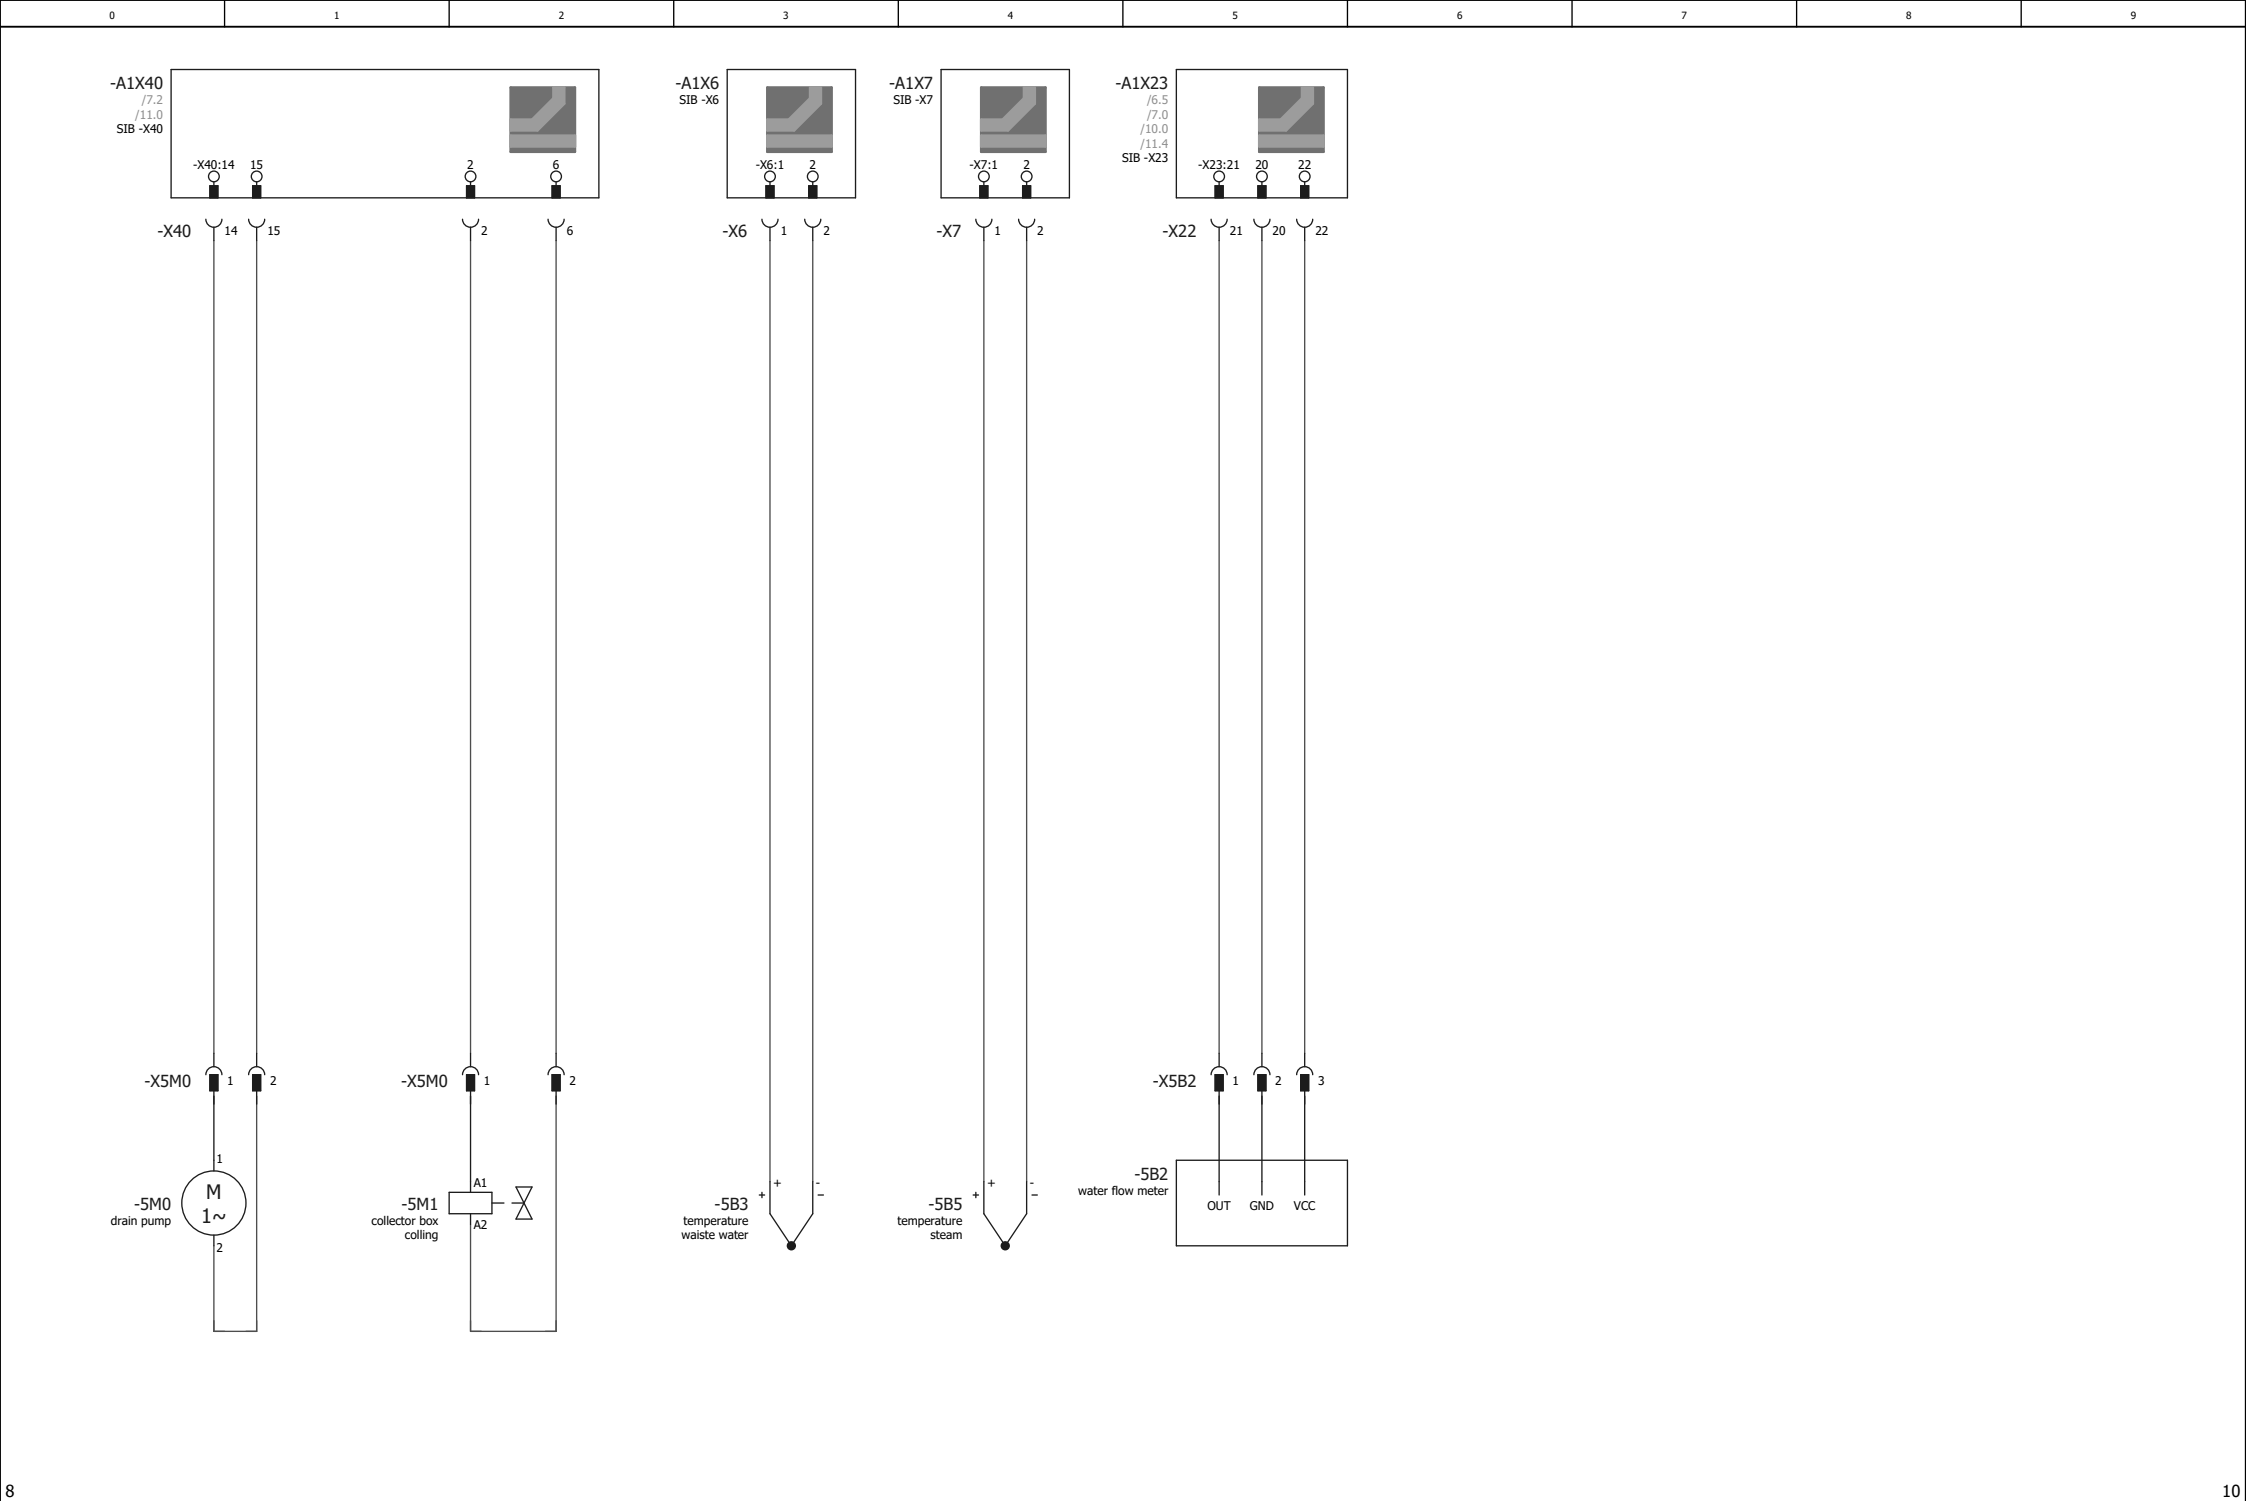

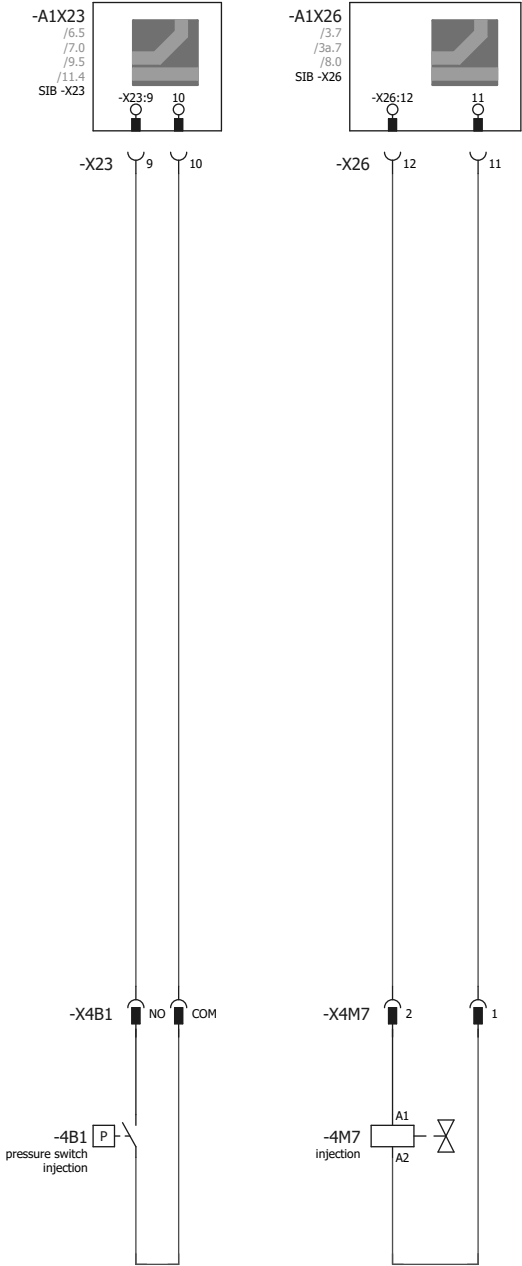

01	ÄM116/2014	23.10.2014	Taf	Drawn	5/25/2022	C4e 20.20 GS	Welbilt Deutschland GmbH Talstraße 35 D-82436 Eglfing / Germany @2014	cleaning	Project No.	= SLP		
02	ÄM158/2015	10.08.2015	SchM	Name	Boe				5354125	+ MPL		
03	ÄM073/2018	26.07.2018	Taf	App.	SchM				Drg. No.			
REV	Remarks	Date	Name	Norm					5153069	Blatt 11 Seite 12 / 13		

